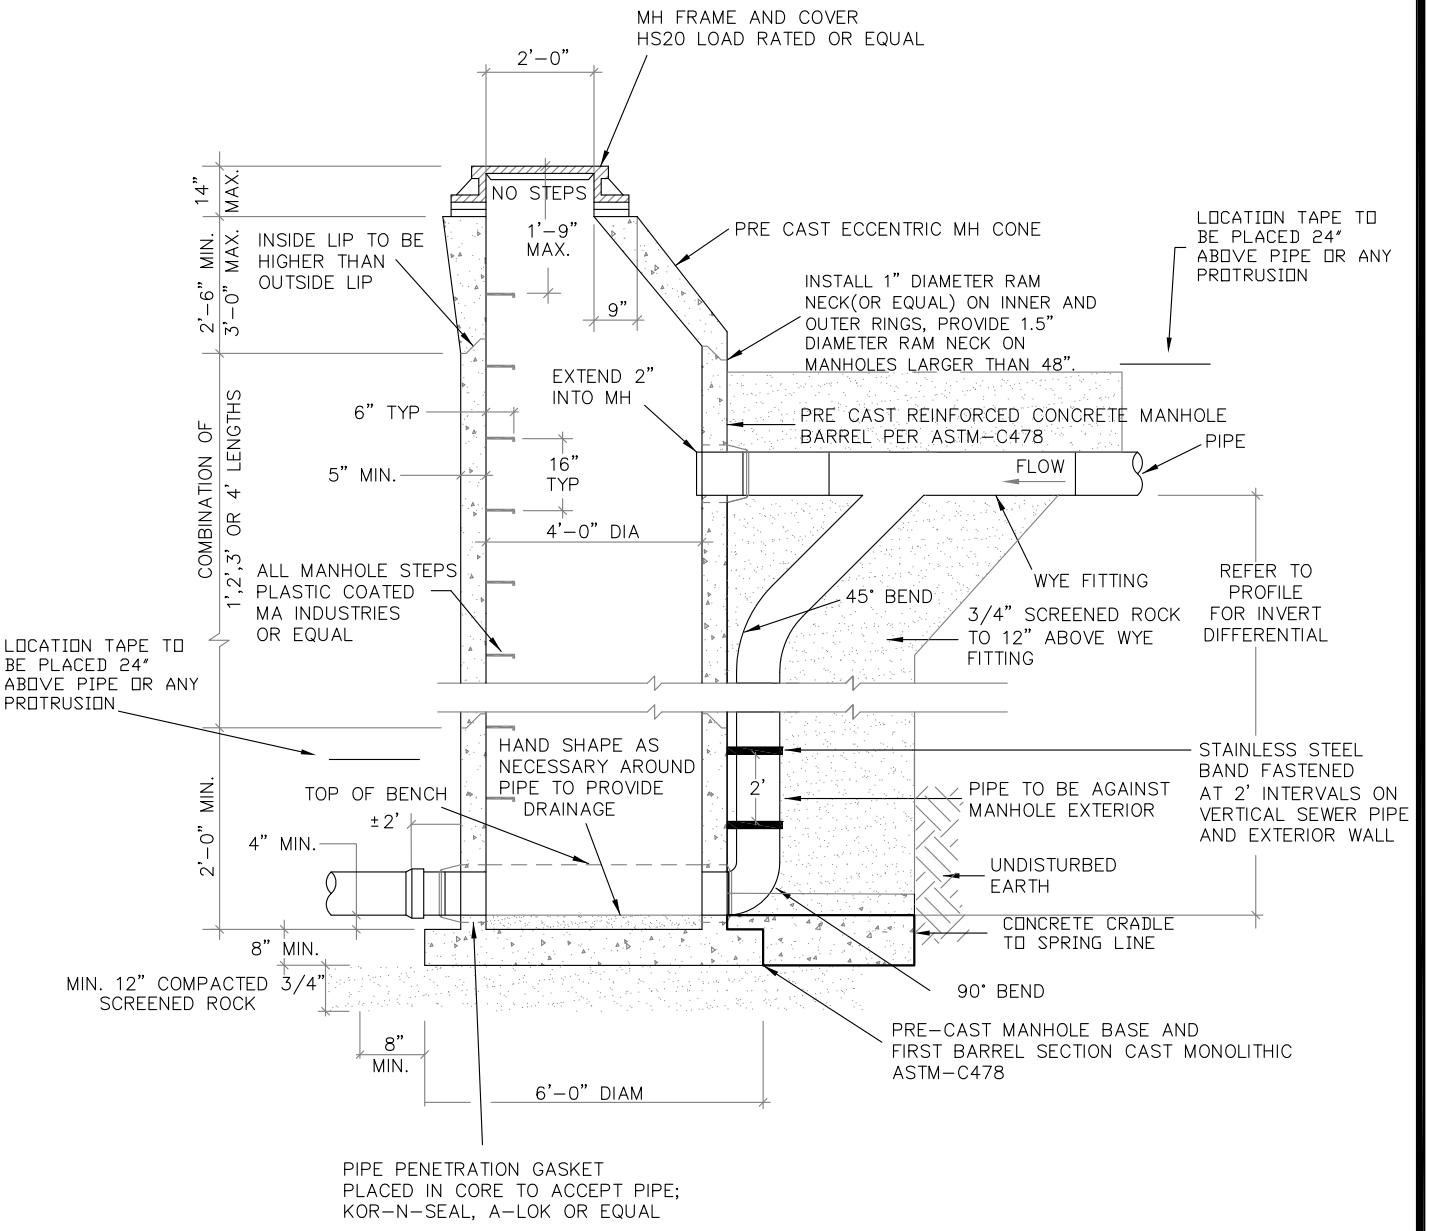

ELEVATION

GENERAL NOTES

1. ALL CONCRETE WORK SHALL COMPLY WITH LATEST ACI-318 SPECIFICATIONS.

2. MANHOLE TROUGH SHALL HAVE A MINIMUM OF .20' DROP FROM ENTRANCE THROUGH EXIT.

3. NO STEPS ARE TO BE CONSTRUCTED IN THE MANHOLE CHIMNEY.

EAGLE RIVER WATER & SANITATION DISTRICT

DROP MANHOLE

SCALE: NONE	DATE: 1-1-09
REVISIONS: 12-31-02	S-2
APPROVED: FOR YEAR 2009	