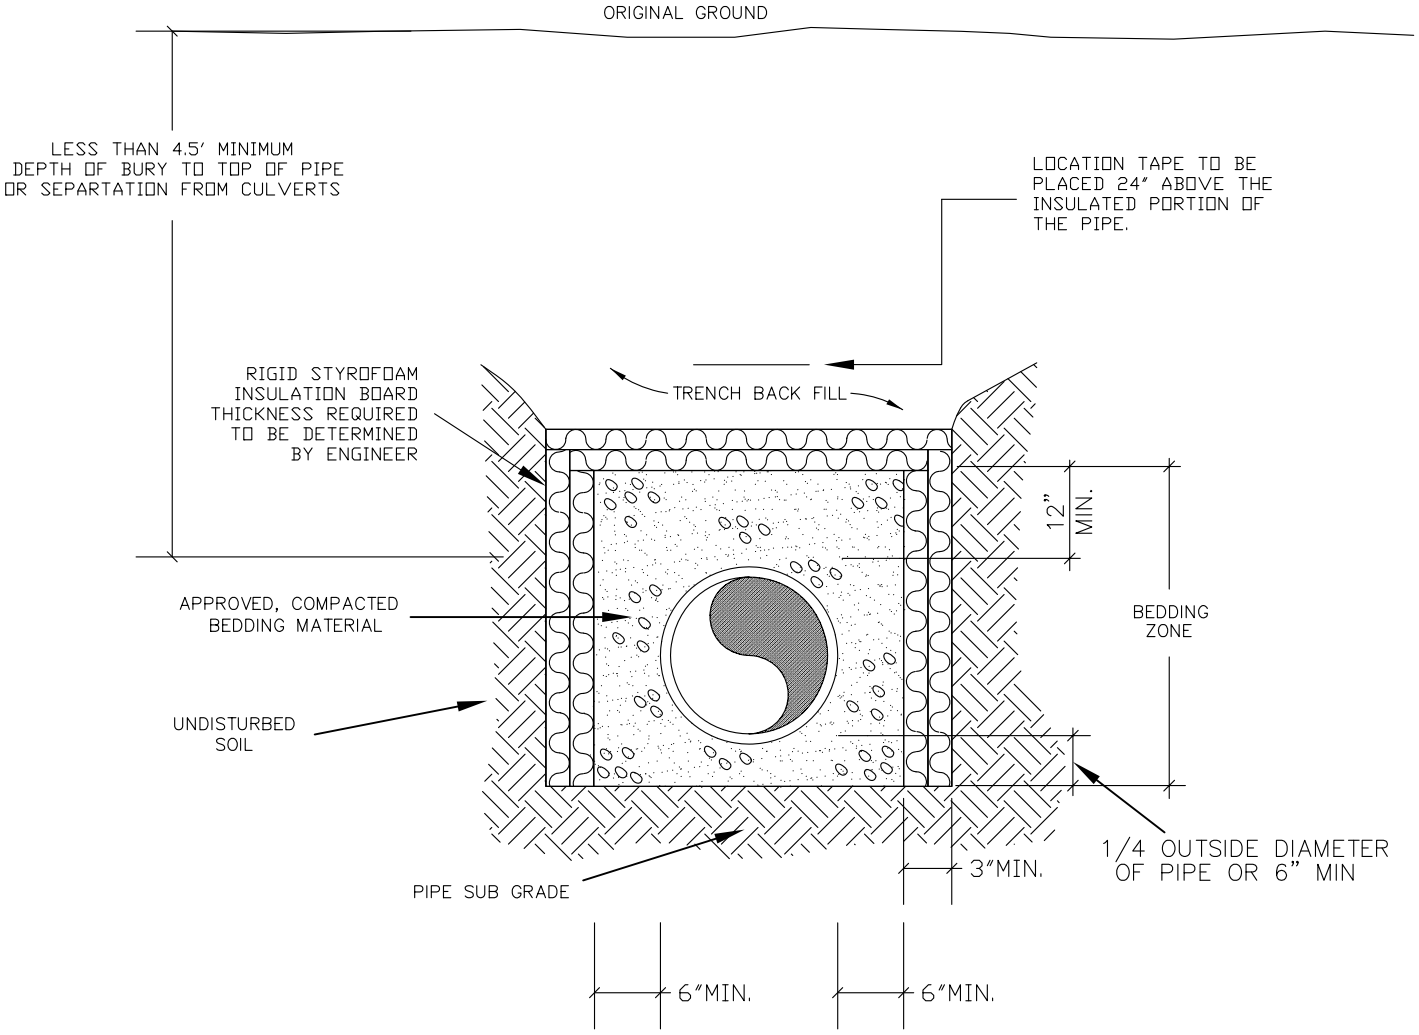

ELEVATION

GENERAL NOTES

1. CONDITION OF LESS THAN MINIMUM BURY DEPTH ALLOWED ONLY WITH WRITTEN APPROVAL FROM THE DISTRICT PRIOR TO CONSTRUCTION. INSULATION SHALL BE INSTALLED ON ALL PIPE THAT DOES NOT MEET MINIMUM BURY REQUIREMENTS.

2. THE USE OF INSULATION MUST BE APPROVED BY THE DISTRICT PRIOR TO INSTALLATION.

3. SEE SEWER AND WATER PIPE BEDDING DETAIL FOR BACK FILL MATERIAL AND COMPACTION SPECS.

4. INSULATION SHALL BE INSTALLED ON ALL PIPE THAT IS WITHIN TWO FEE OF ANY DRAINAGE CULVERT. THIS APPLIES TO THE BOTTOM OF THE PIPE IF IT CROSSES OVER THE TOP OF THE CULVERT.

EAGLE RIVER WATER & SANITATION DISTRICT

SEWER PIPE INSULATION DETAIL

SCALE: NONE	DATE: 01-01-09
REVISIONS: 01-01-06	S-14
APPROVED: FOR YEAR 2009	