


TABLE 3-1


SEWER PIPE COVER DEPTH	MINIMUM EASEMENT WIDTH REQUIRED
4'6" TO 8'6"	20'
8'7" TO 11'0"	25'
11'1" TO 13'6"	30'
13'7" TO 16'0"	35'
16'1" TO 18'6"	40'
18'7" TO 21'0"	45'
21'1" TO 23'6"	50'

PIPE SHALL BE CENTERED IN EASEMENT

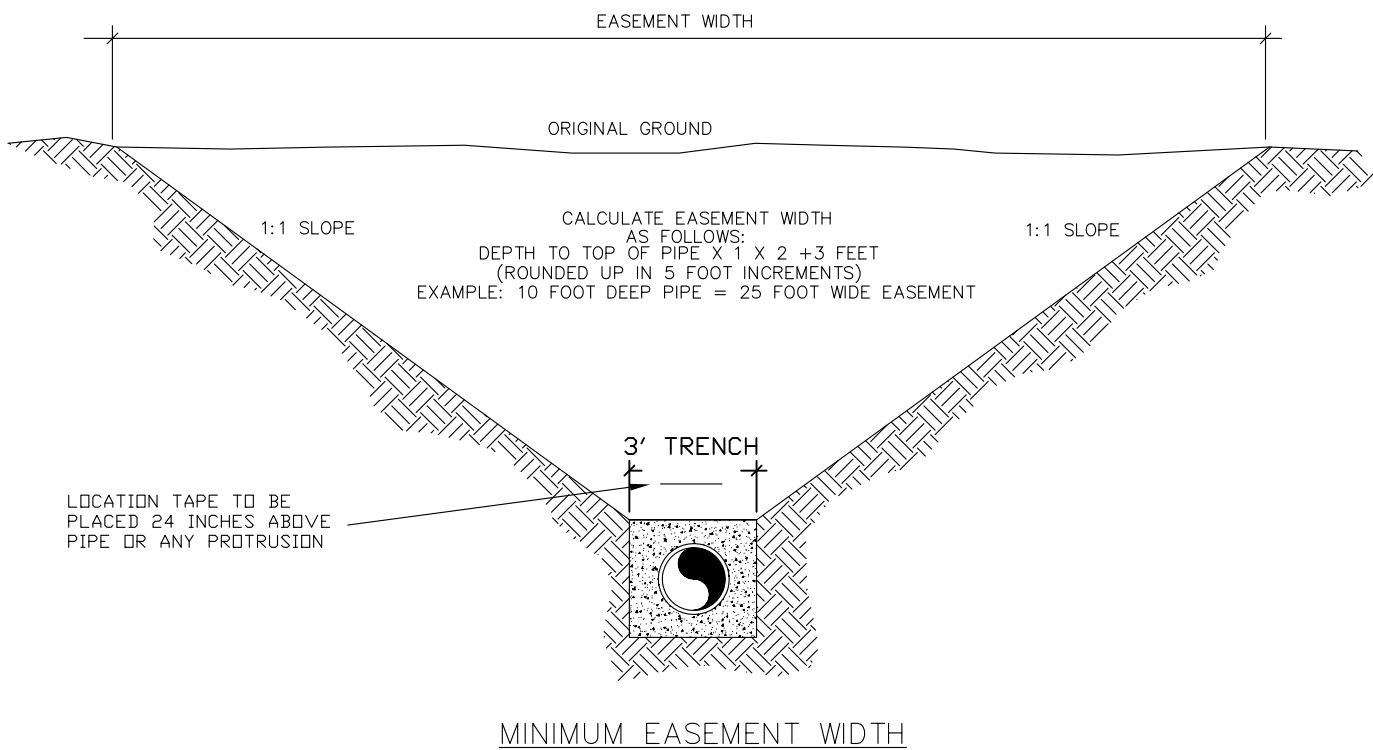

GENERAL NOTES

1. PIPE SHALL BE CENTERED IN EASEMENT

 EAGLE RIVER WATER & SANITATION DISTRICT	
EASEMENT WIDTH DETAIL	
SCALE: NONE	DATE: 01-01-09
REVISIONS: 01-01-06	S-15
APPROVED: FOR YEAR 2009	