


ALL BEDDING MATERIAL MUST BE COMPACTED TO DISTRICT STANDARDS

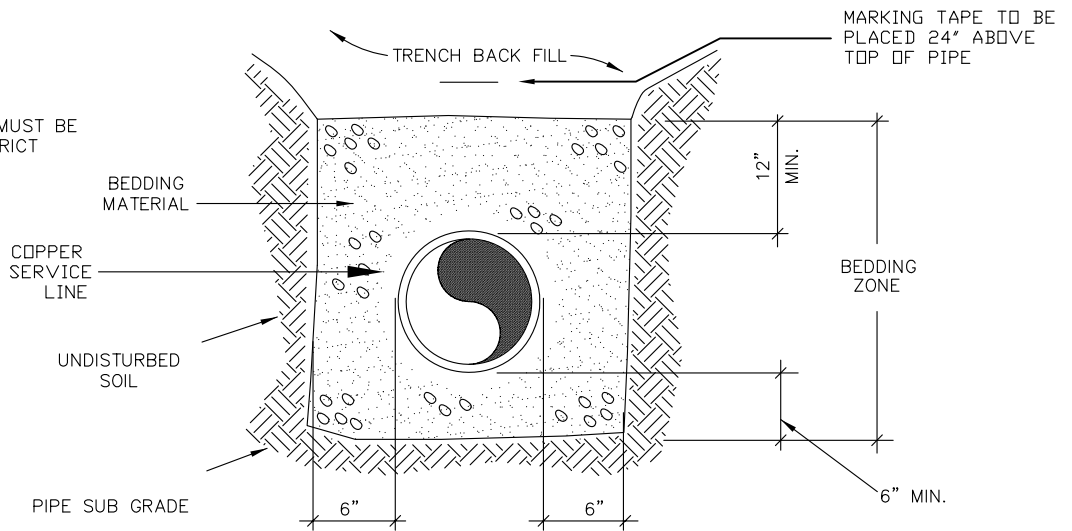


APPROVED CURB BOXES
 FOR CURBSTOPS UP TO 1":
 MUELLER H10314 WITH 89982 LID WITH 1" SHAFT OR
 McDONALD #5601 WITH 5601L LID
 FOR CURBSTOPS LARGER THAN 1":
 MUELLER H10314 WITH 89982 LID WITH 1" SHAFT AND
 TYLER 6500 SERIES ENLARGED BASE # 144809 OR
 McDONALD #5603 WITH 5601L LID

SERVICE STUB-OUT BEDDING


6' STEEL FENCE POST-
 PAINT TOP 1' OF POST BLUE

PROPERTY LINE OR
 EDGE OF EASEMENT

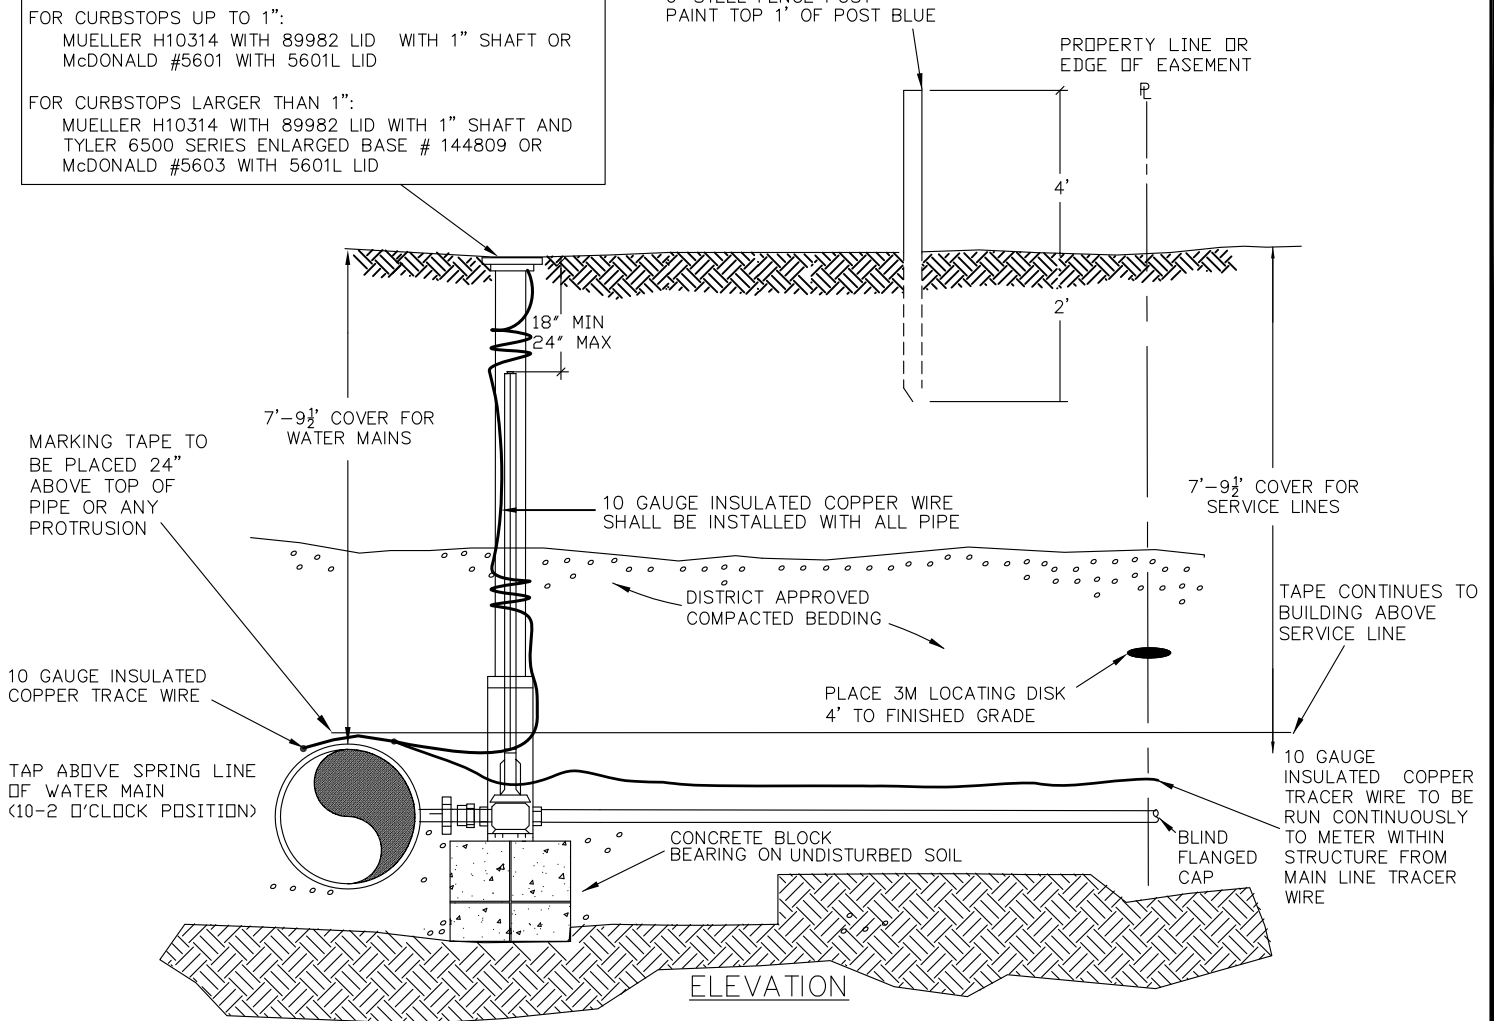

GENERAL NOTES

1. CURB STOP TO BE LOCATED AT THE PROPERTY LINE OR AT THE EDGE OF EASEMENT-WHICHEVER IS CLOSER TO THE MAIN.
2. SERVICE LINE CORP. STOP TO BE TAPPED AT SPRING LINE OF WATER MAIN.
3. CURB STOP AND RISER ARE TO BE INSTALLED PLUMB AND LEVEL, AND VALVE SHAFT EXTENSION SHALL BE INCLUDED AND CENTERED.
4. VALVE SHAFT SHALL BE EXTENDED TO WITHIN 18" OF FINISH GRADE OR LID OF VALVE BOX WHICHEVER IS HIGHER.

 EAGLE RIVER WATER & SANITATION DISTRICT	
WATER SERVICE STUB OUT	
SCALE: NONE	DATE: 01-01-09
LAST REVISED: 10-02-03	W-02
APPROVED FOR YEAR 2009	