



IF THE DISTANCE TO THE TOP OF THE OPERATING NUT TO THE TOP OF THE VALVE COVER IS GREATER THAN 9', AN EXTENSION STEM WILL BE REQUIRED ON THE OPERATING NUT. THE EXTENSION MUST BE SECURED TO THE VALVE OPERATING NUT.

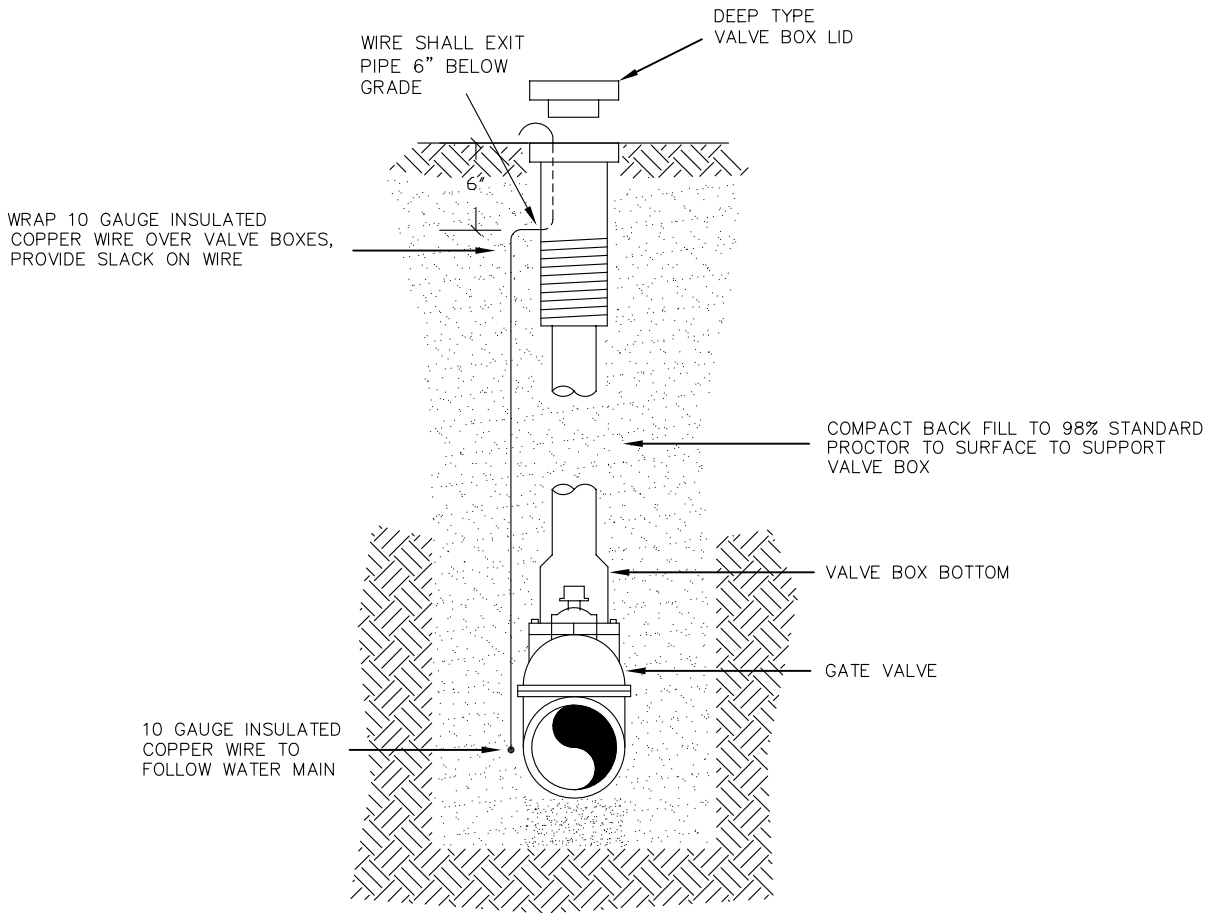

GENERAL NOTE

1. VALVE BOX IS TO BE INSTALLED PLUMB, LEVEL, AND CENTERED ON 2" NUT

 EAGLE RIVER WATER & SANITATION DISTRICT	
GATE VALVE AND BOX ASSEMBLY	
SCALE: NONE	DATE: 01-01-09
LAST REVISION: 12-31-01	W-08
APPROVED FOR YEAR 2009	