



TOP VIEW

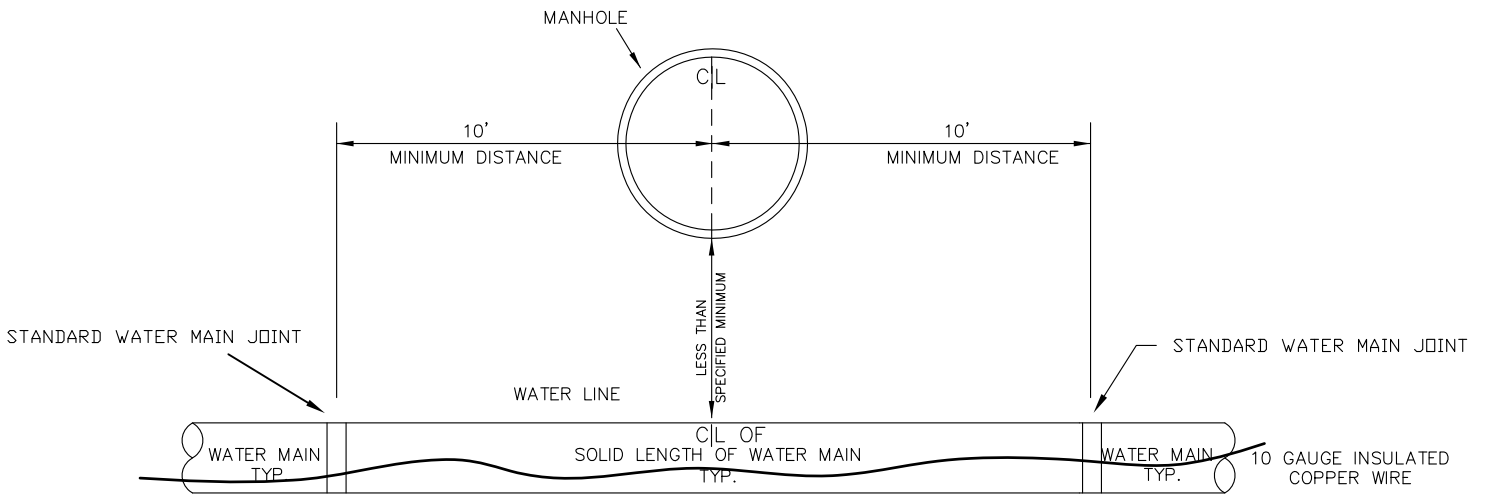

FOR WATER MAIN/MANHOLE ENCROACHMENT INTO 10' BUFFER

IF WATER MAIN IS LESS THAN SPECIFIED DISTANCE FROM A SEWER MANHOLE(HORIZONTALLY), OR IF WATER MAIN IS BELOW THE SEWER MANHOLE, INSTALL WATER MAIN SECTION CENTERED ON THE CENTER LINE OF THE ENCROACHING MANHOLE AND JOINTS A MINIMUM OF 10' AWAY FROM CENTER LINE OF MANHOLE.

 EAGLE RIVER WATER & SANITATION DISTRICT	
WATER MAIN/ MANHOLE SEPARATION	
SCALE: NONE	DATE: 01-01-09
LAST REVISED: 10/24/00	W-14
APPROVED FOR YEAR 2009	