


WATER MAIN COVER DEPTH	MINIMUM EASEMENT WIDTH REQUIRED
7' TO 8'6"	20'
8'7" TO 9'6"	25'

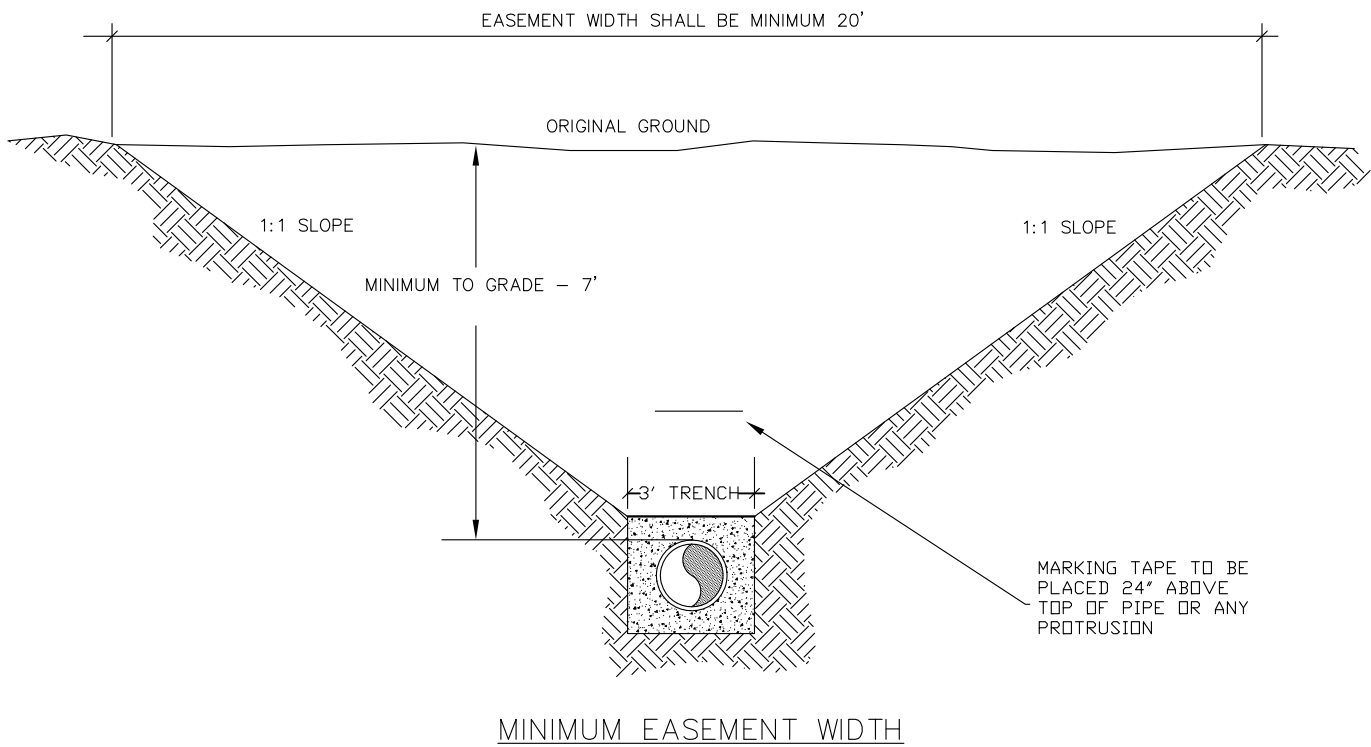

GENERAL NOTES

1. PIPE SHALL BE CENTERED IN EASEMENT.

EAGLE RIVER WATER & SANITATION DISTRICT	
EASEMENT WIDTH DETAIL	
SCALE: NONE	DATE: 01-01-09
LAST REVISED: 12-31-02	
APPROVED FOR YEAR 2009	W-21